Click to go to centralboiler.com

Radiant Floor Heat

Heating Upper Level

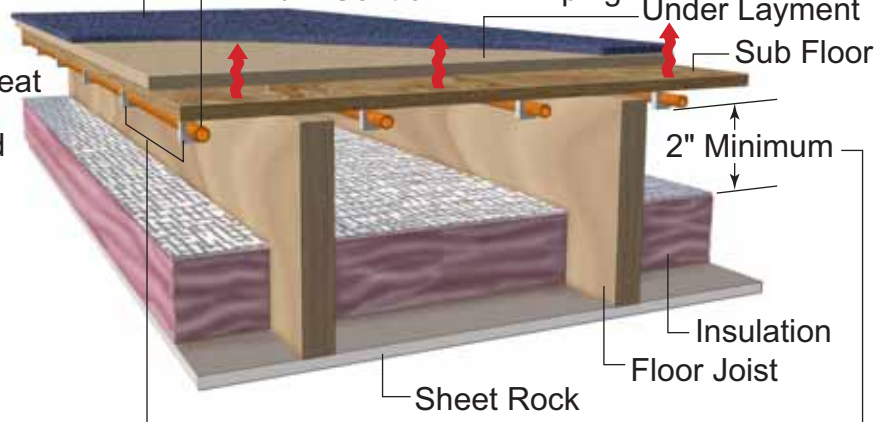

PEX Hangers should be installed every 18".

It is recommended that you maintain a 2" cavity between piping and insulation for best performance.

Heating Lower and Upper Level

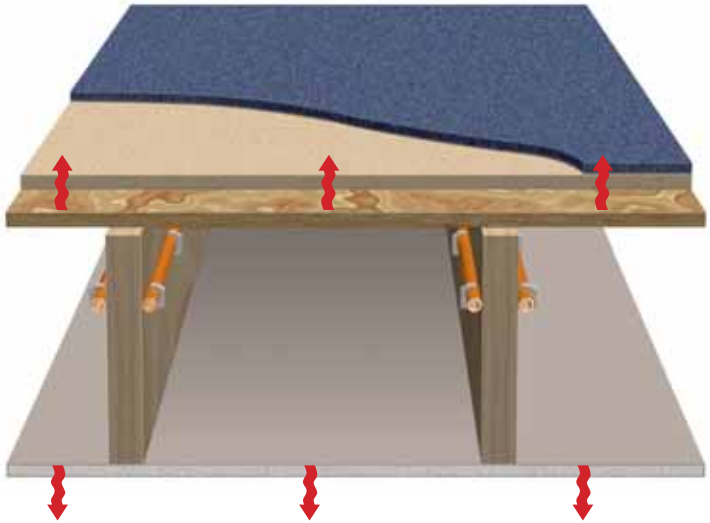

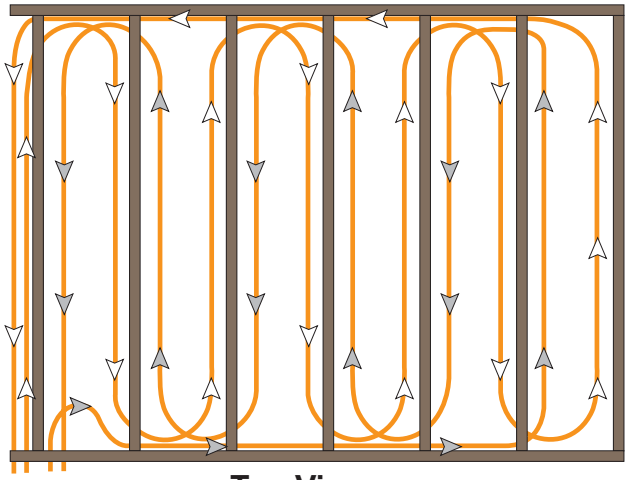

Top View

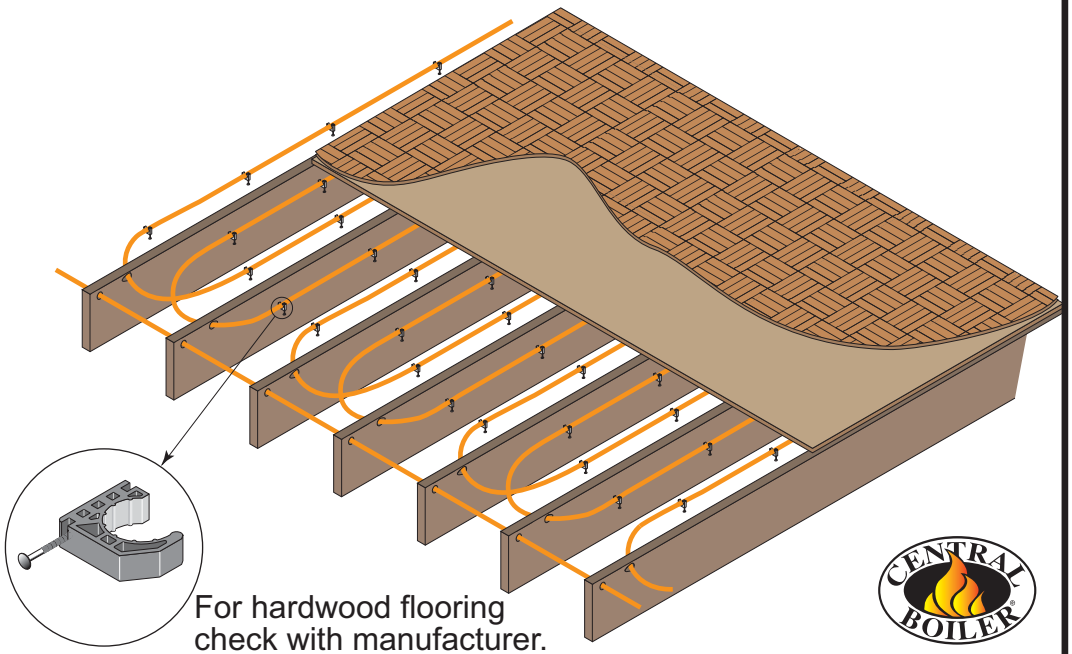

For hardwood flooring check with manufacturer.

 © 2013 Central Boiler