


# Existing Boiler (Direct Plumbed) Depressurized

## NOTE

Installer must comply with all applicable codes and regulations.

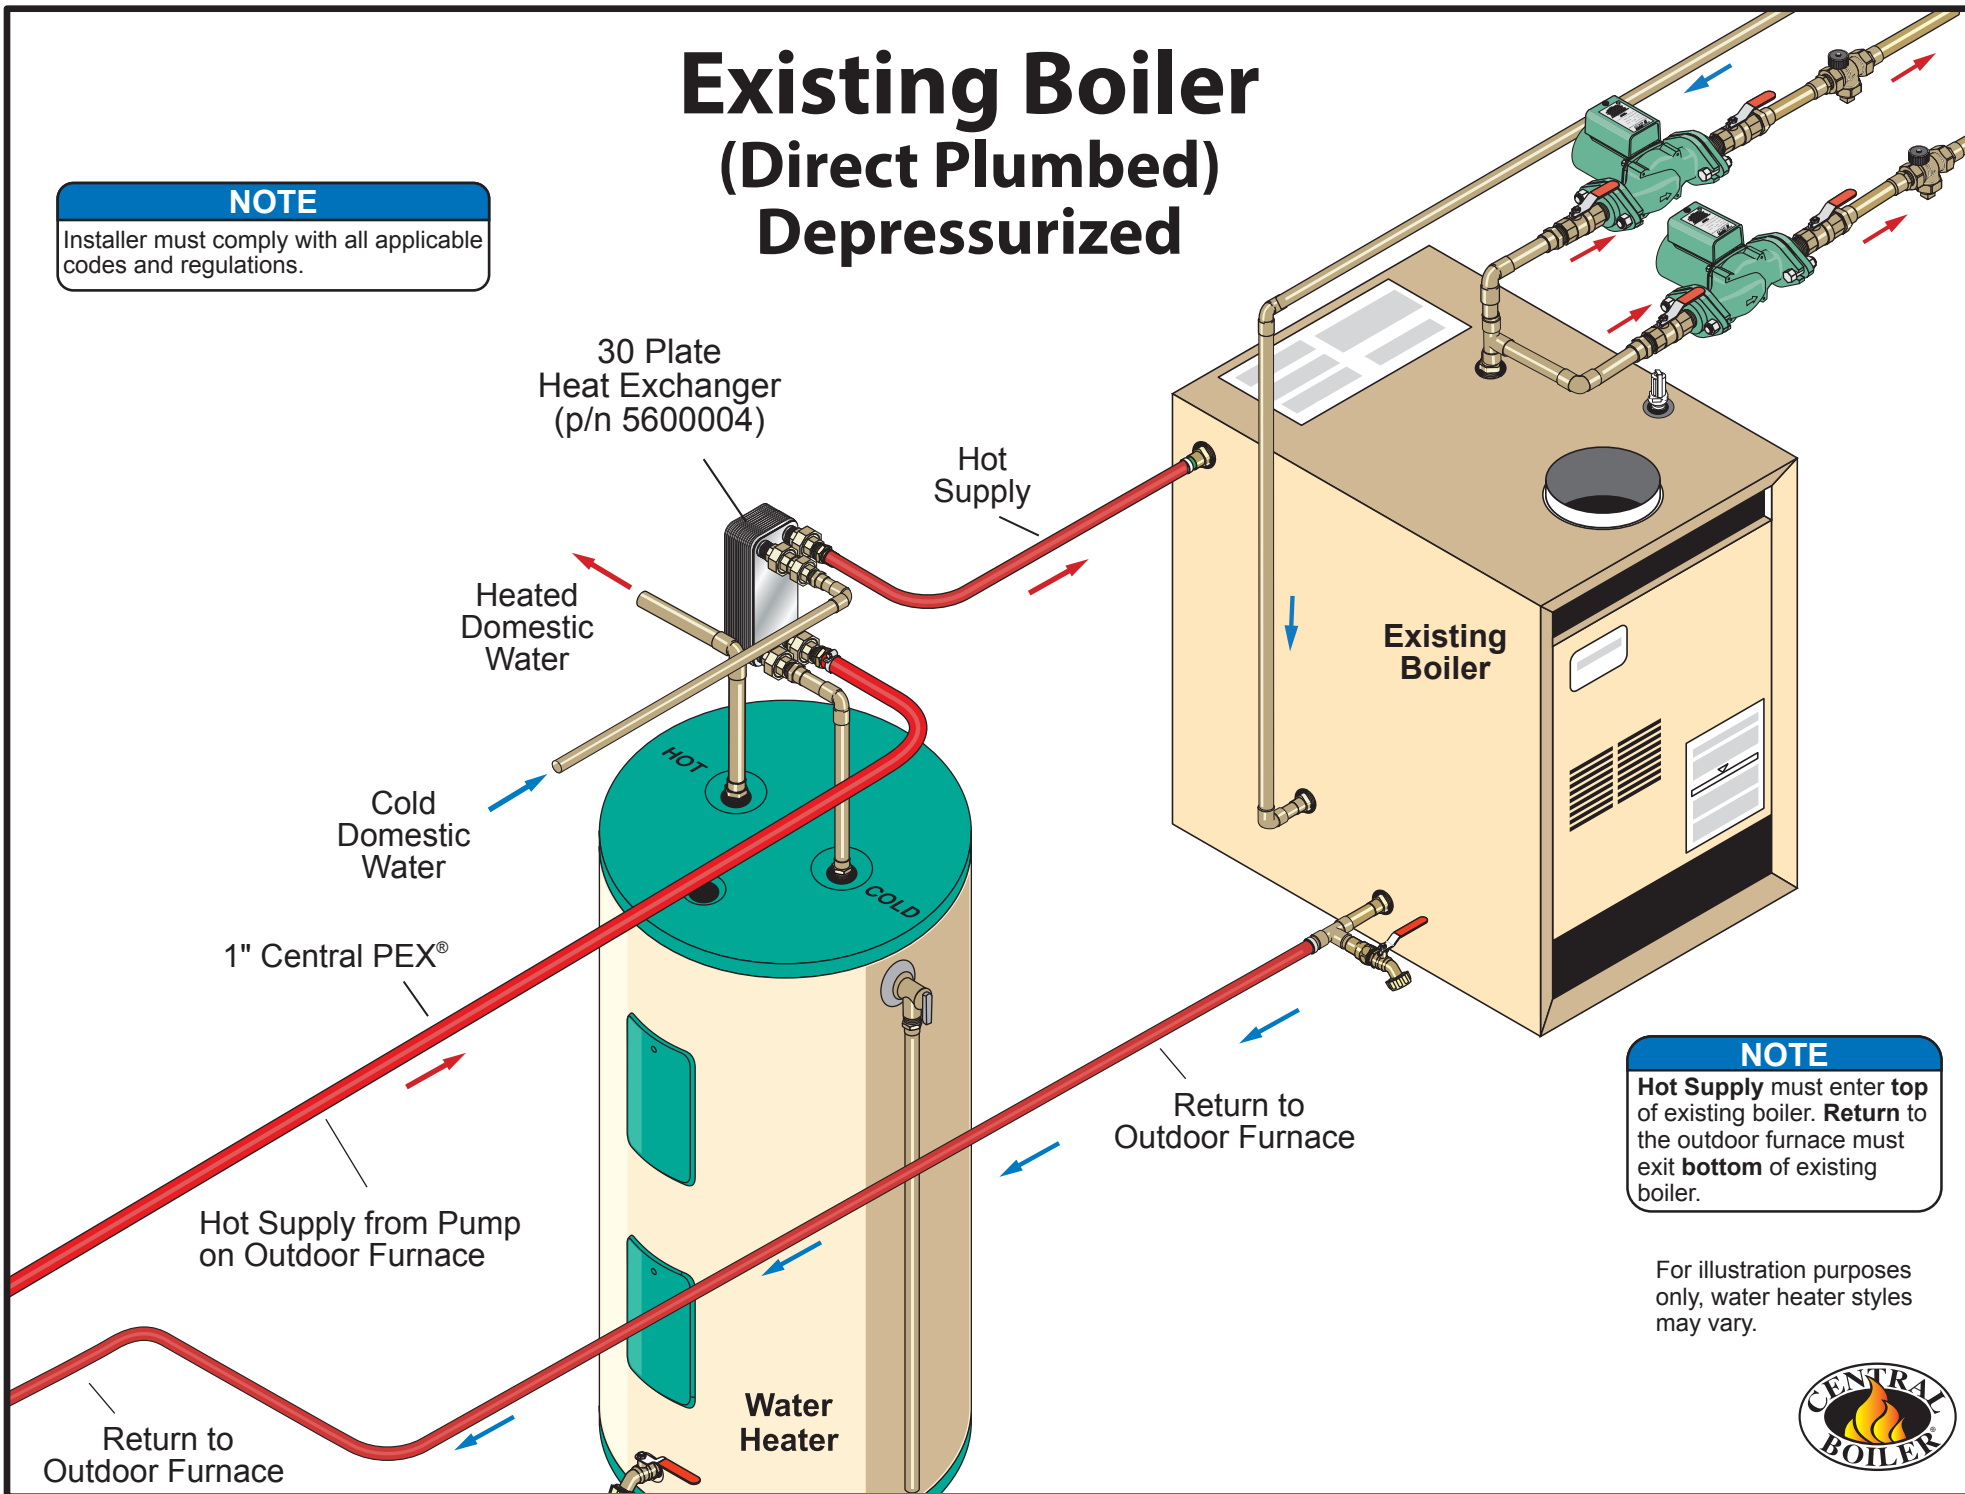

## NOTE

Hot Supply must enter top of existing boiler. Return to the outdoor furnace must exit bottom of existing boiler.

For illustration purposes only, water heater styles may vary.

