



# Baseboard System (Three Way Zone Valve Controlled)

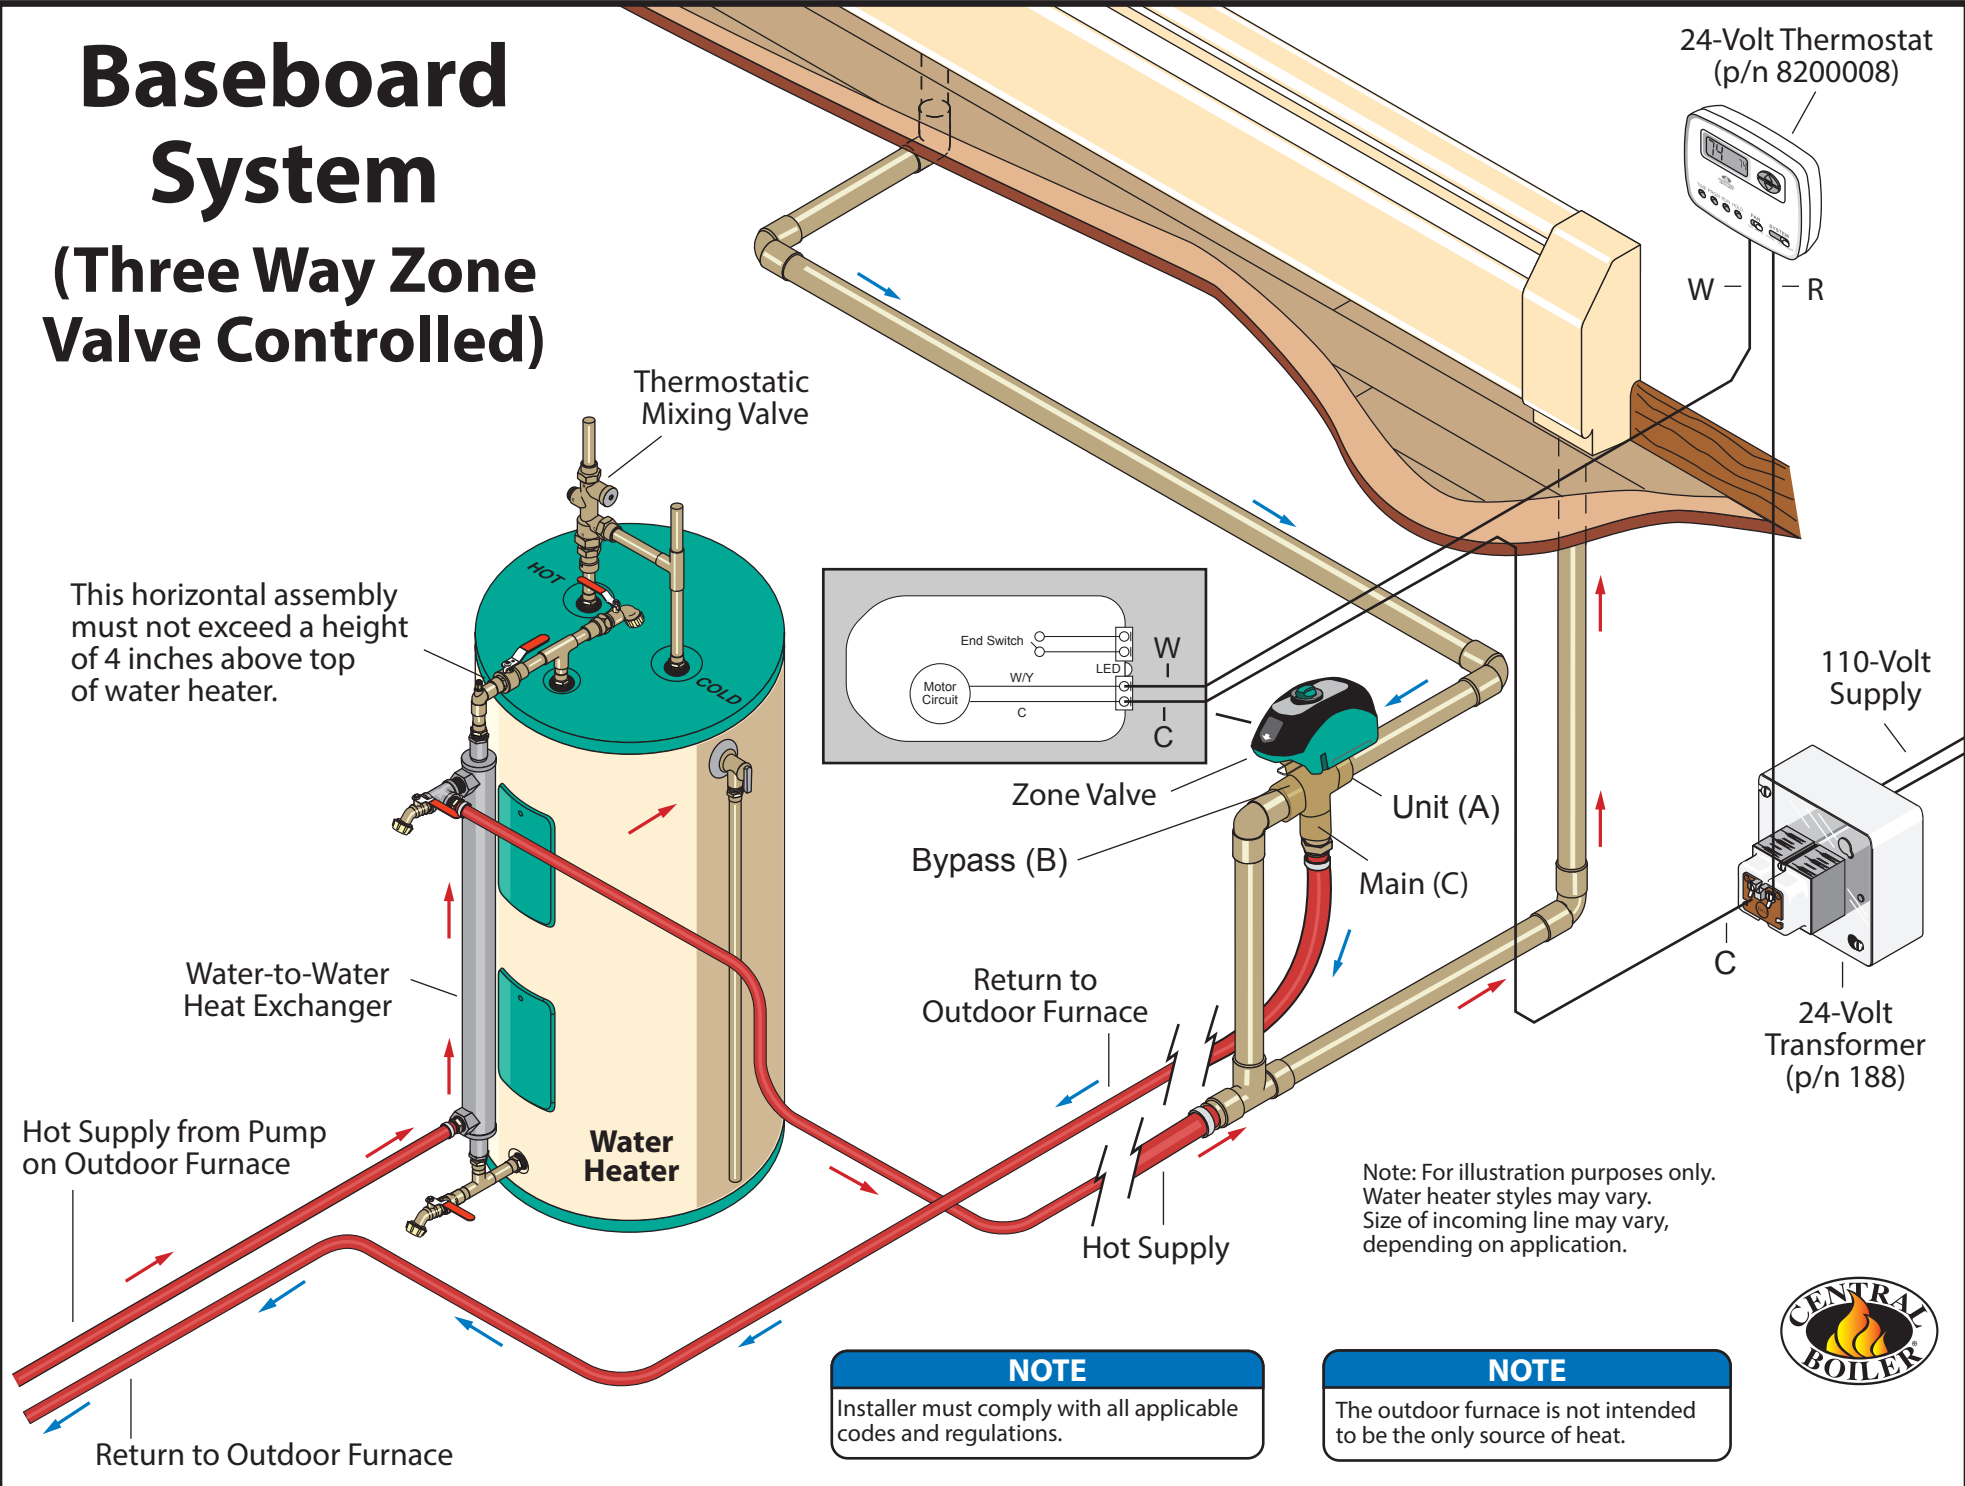

This horizontal assembly must not exceed a height of 4 inches above top of water heater.

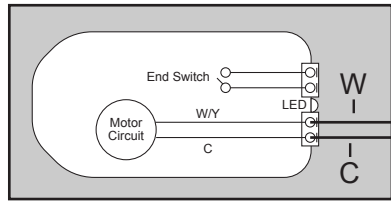

**NOTE**  
Installer must comply with all applicable codes and regulations.

**NOTE**  
The outdoor furnace is not intended to be the only source of heat.

