


Multi Zone In-Floor

Hot Supply from Pump on Outdoor Furnace



Return to Outdoor Furnace

1" Copper Piping

Mixing Valve

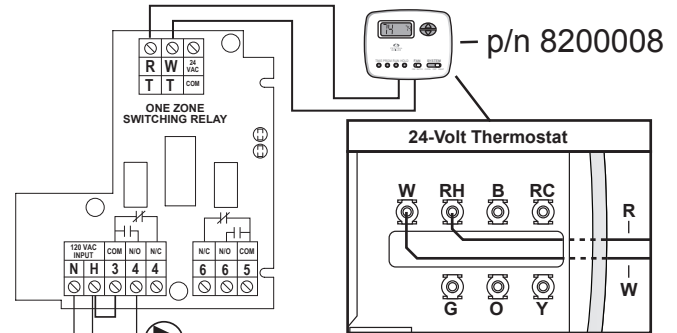

NOTE
Installer must comply with all applicable codes and regulations.

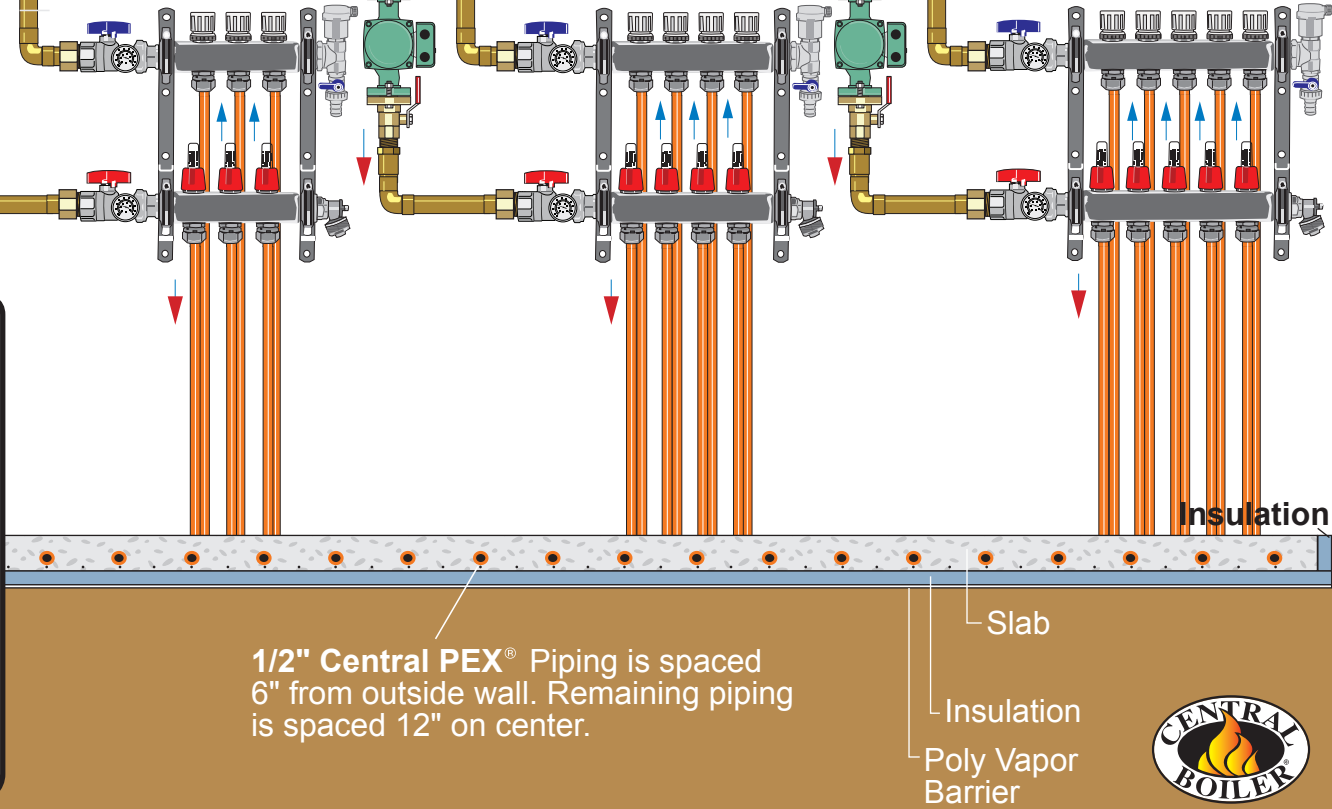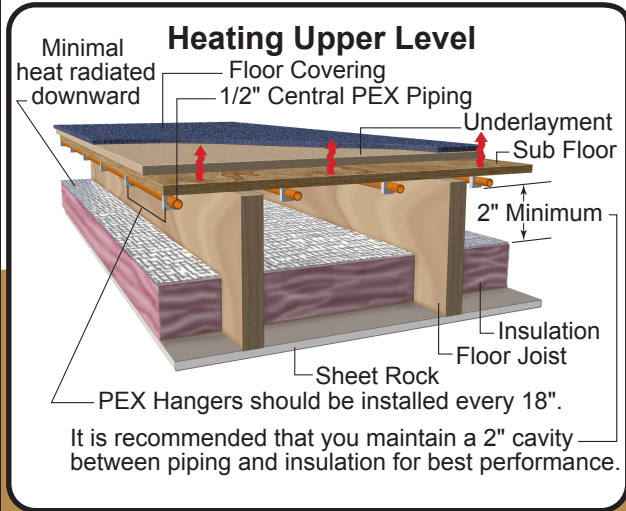

1/2" Central PEX® Piping is spaced 6" from outside wall. Remaining piping is spaced 12" on center.

