



# CL 6048 with 3 Pumps Installed

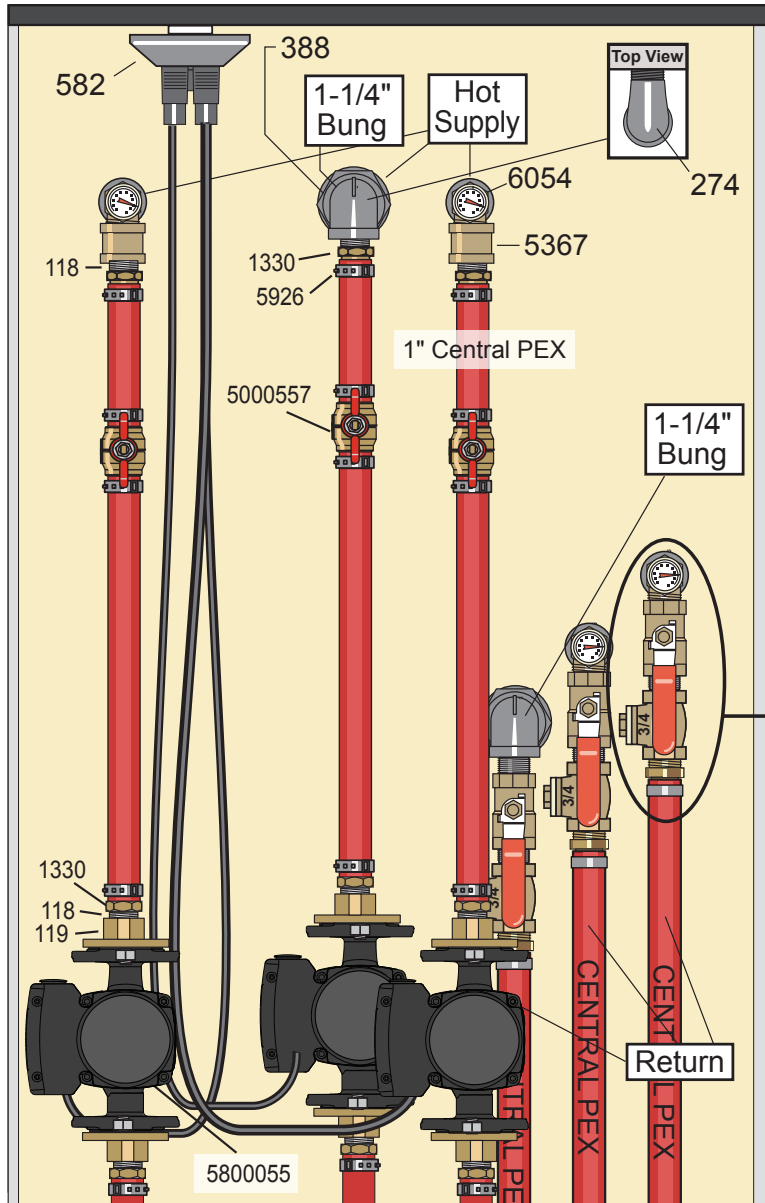


Parts List*		
Qty	p/n	Description
3	118	3/4" Close Nipple
3	119	Pump Flange Kit, 3/4"
12	5926	Clamp Crimp Ring, 1"
2	274	3/4" Black 90° Street Elbow
3	296	3/4" Swing Check Valve
2	388	1-1/4" x 3/4" Bushing
3	5000557	Ball Valve, Full Port, PEX 1"
3	556	Power Supply Cord, 32"
1	582	6 Outlet Converter
6	1330	3/4" x 1" MPT to PEX
4	3042	1/2" x 1/8" Bushing
2	5367	3/4" Brass Coupling
4	6054	Temperature Gauge
1	6593	Grounding Rod Kit
2	6764	3/4" x 3/4" x 1/2" Offset Tee
3	5800055	Pump, UPMS 20-58 F

\*Parts and accessories sold separately.

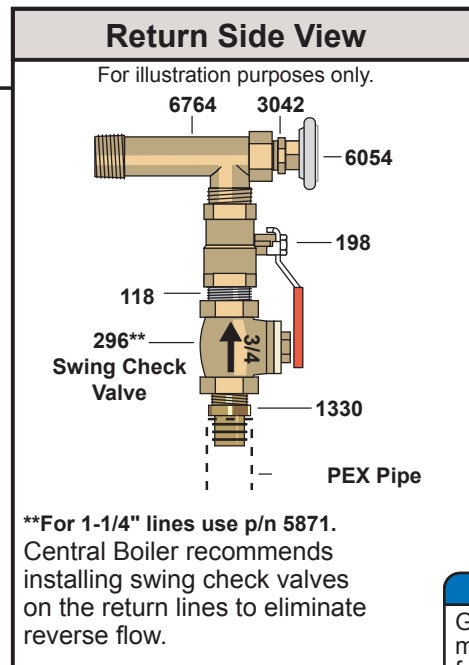

\*\*For 1-1/4" lines use p/n 5871.  
Central Boiler recommends installing swing check valves on the return lines to eliminate reverse flow.

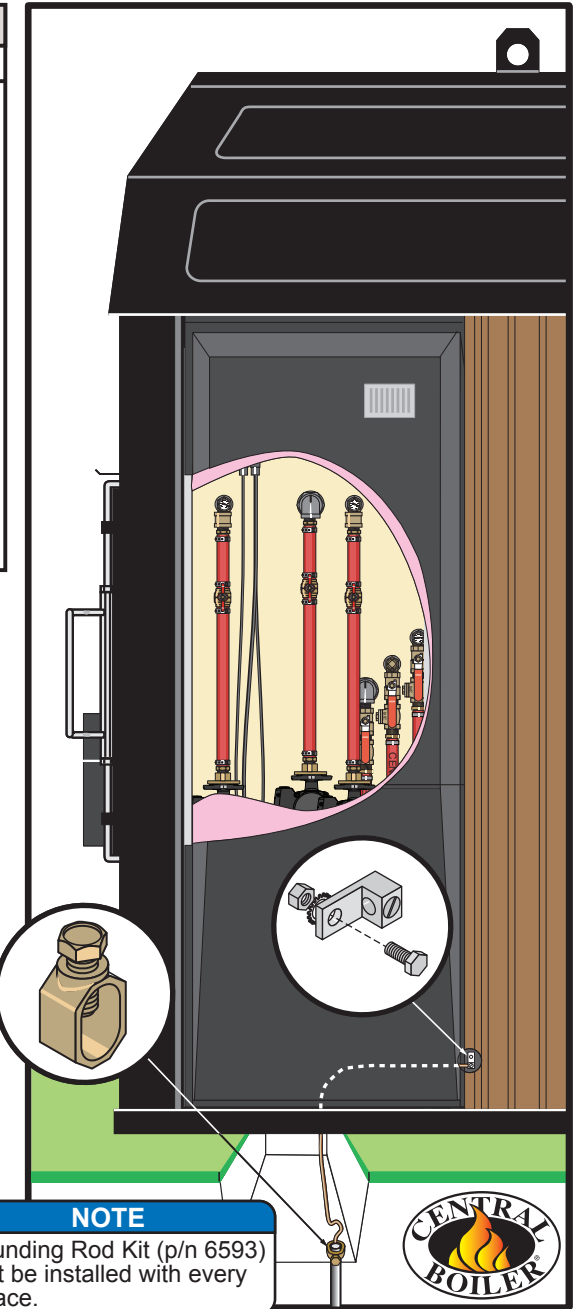

**NOTE**  
Grounding Rod Kit (p/n 6593) must be installed with every furnace.

For illustration purposes only. Different configurations may be used. However, it is recommended to mount the pumps as low as possible to lessen cavitation and pump problems.

