


CL 5036 with Pump Installed in Building

Use a 1/2" x 1/8" bushing with temperature gauges.



Hot Supply

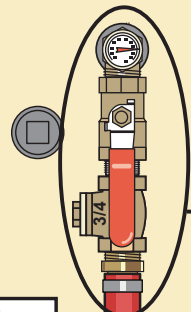

Return


CENTRAL PEX

Parts List*		
Qty	p/n	Description
1	118	3/4" Close Nipple
2	198	3/4" Ball Valve
1	296	3/4" Swing Check Valve
2	1330	3/4" x 1" MPT to PEX
2	3042	1/2" x 1/8" Bushing
2	6054	Temperature Gauge
1	6593	Grounding Rod Kit


*Parts and accessories sold separately.

Return Side View

For illustration purposes only.

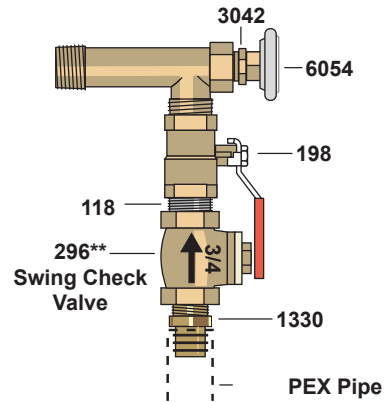

**For 1-1/4" lines use p/n 5871.
Central Boiler recommends installing swing check valves on the return lines to eliminate reverse flow.

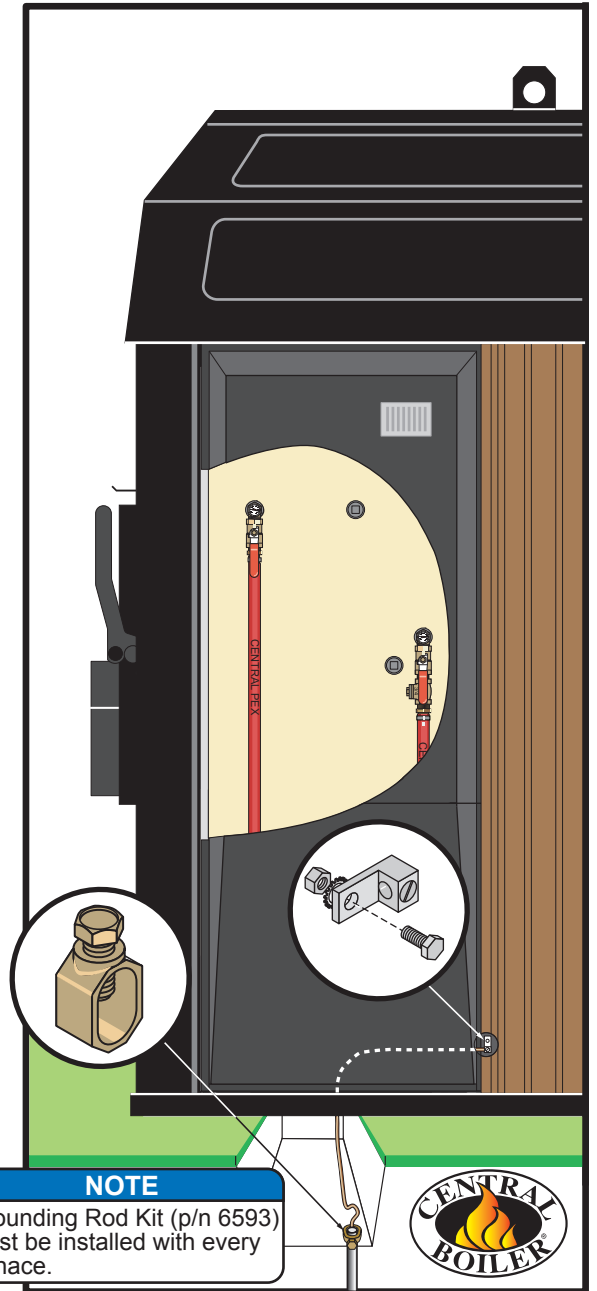

NOTE

Grounding Rod Kit (p/n 6593) must be installed with every furnace.

