


Dual System (Baseboard / Forced Air)

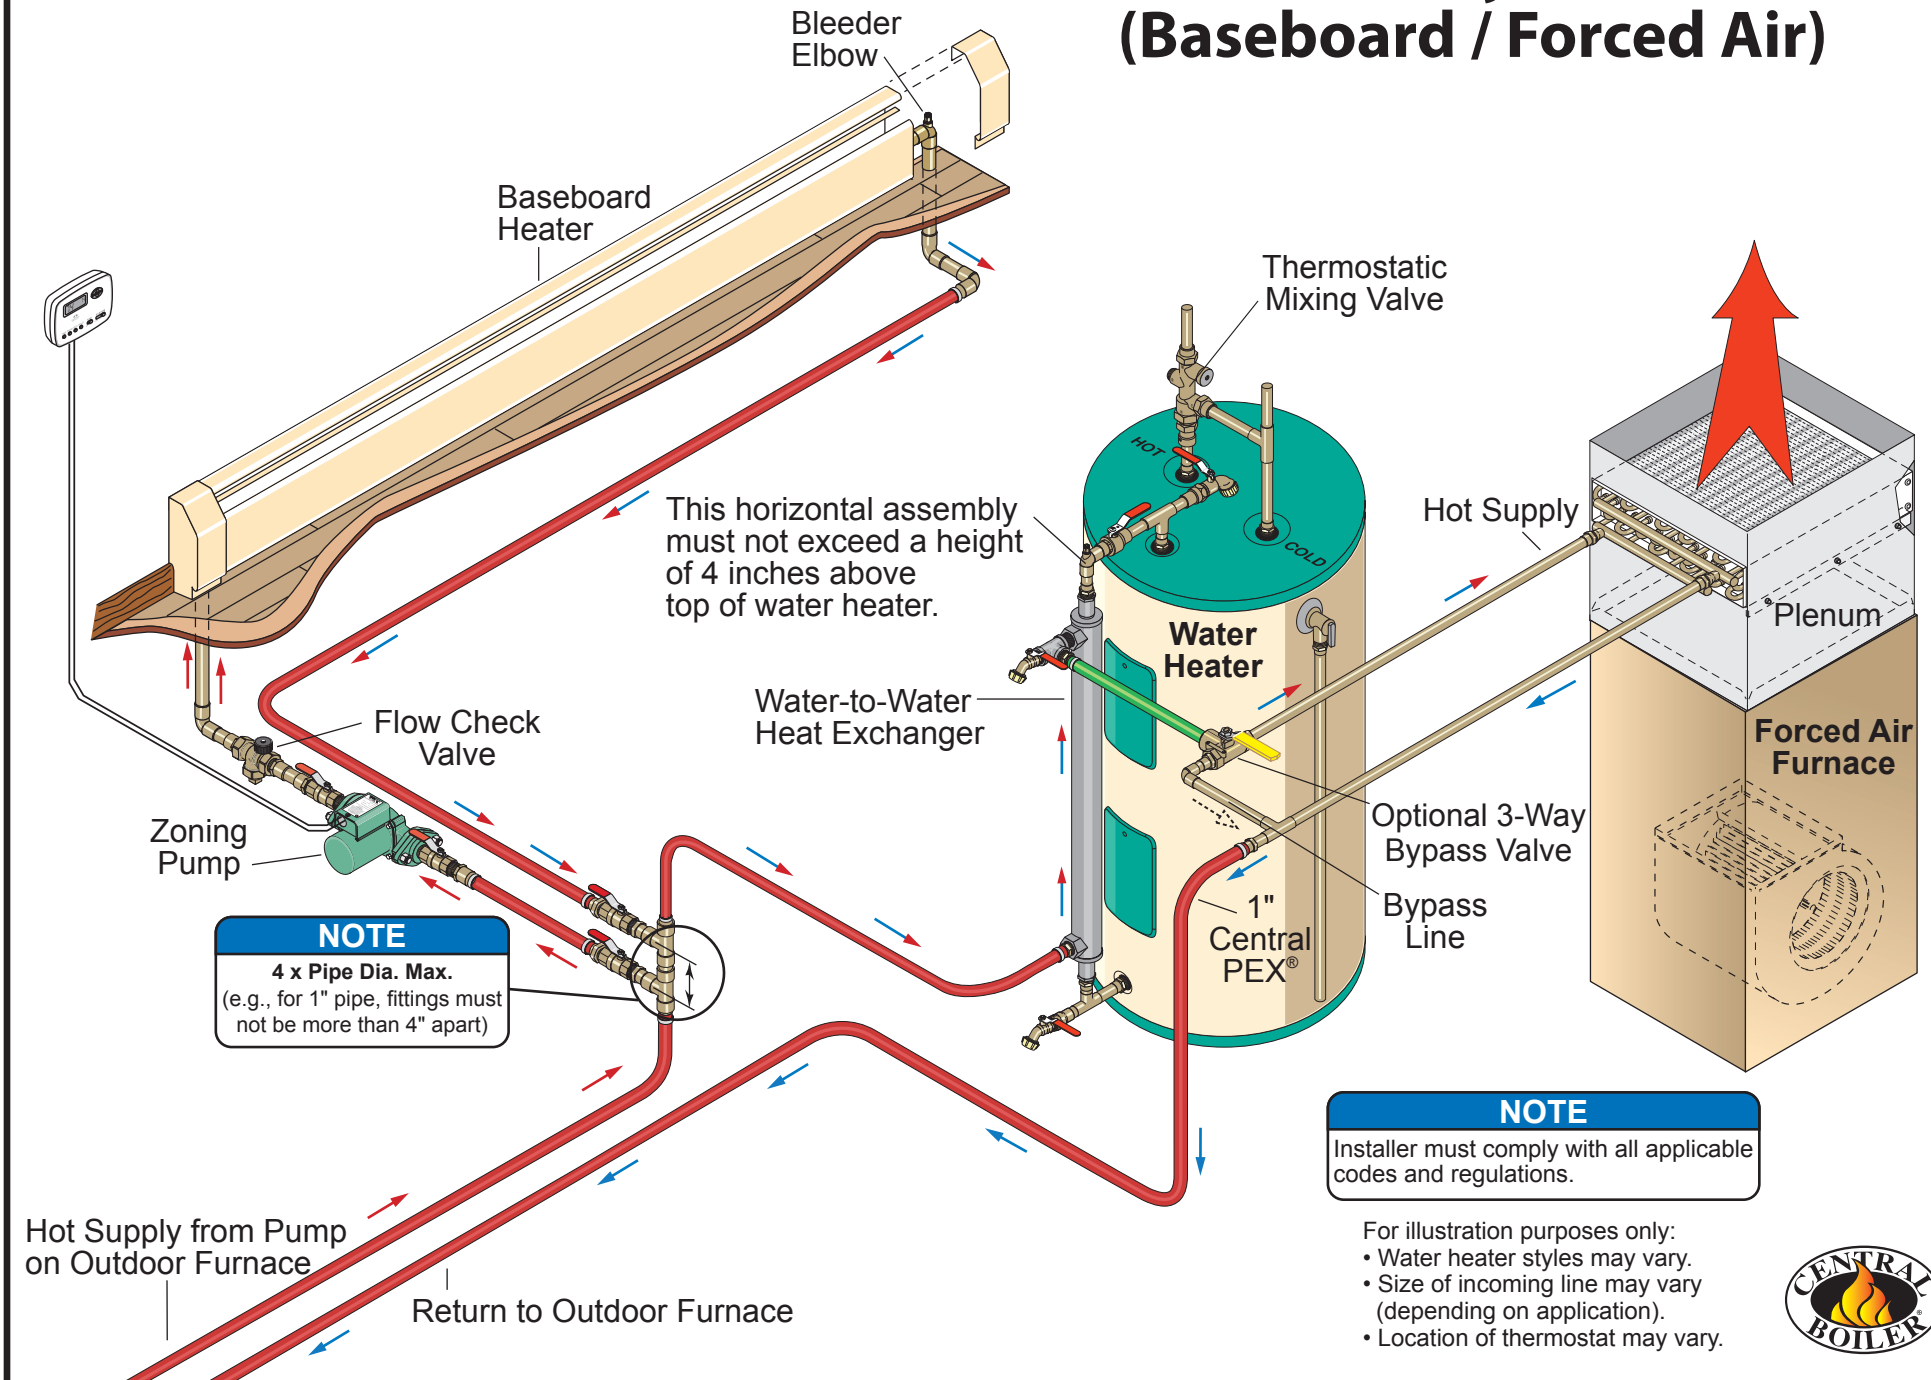

NOTE
4 x Pipe Dia. Max.
(e.g., for 1" pipe, fittings must not be more than 4" apart)

NOTE
Installer must comply with all applicable codes and regulations.

For illustration purposes only:
• Water heater styles may vary.
• Size of incoming line may vary (depending on application).
• Location of thermostat may vary.

